

## Ontario Building Code Reference:

9.4.2.3. Platforms Subject to Snow and Occupancy Loads intended for an occupancy and subject to snow loads shall be designed to carry the specified roof snow load or 1.9 kPa (40 psf), whichever is greater, where the platform, or each segregated area of the platform, serves a single dwelling unit.

## Ontario Building Code Compliance:

This deck board complies for the use under the Ontario Building Code is in all areas of Ontario with specified snow loads listed in the Supplementary Standard SB-1 (2012) - Climatic and Seismic Information for Building Design in Ontario. Spacing of supports to be at max. 711c/c (28"c/c) for areas with a specified snow load of 4.8kPa or less.

## **Uplift Capacity:**

Maximum allowable uplift capacity for two #10x2-3/4in. OMG FastenMaster Cortex composite deck screw per joist = 7.1 kPa (148 psf)


Maximum allowable uplift capacity for two #8x2-1/2"in. HEADCOTE 305/316 composite deck screw per joist = 7.1 kPa (149psf)

Maximum allowable uplift capacity for Hidefast HF 25 hidden fastener per joist - 6.4 kPa (133psf)

(The first and last deck boards must be face fastened with #10x2-3/4in. OMG FastenMaster Cortex composite deck screws.)

This value to be used in conjunction with the specified wind loads listed in the Supplementary Standard SB-1 - Climatic and Seismic Information for Building Design in Ontario September 14, 2012.



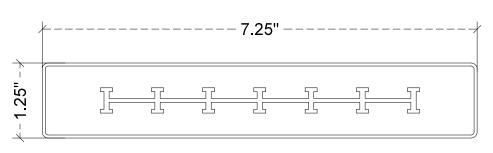


- CONTRACTOR SHALL CHECK ALL DIMENSIONS ON THE WORK SITE AND REPORT DISCREPANC TO THE CONSULTANTS BEFORE PROCEEDING.
- LL DRAWINGS AND SPECIFICATIONS ARE
- PROPERTY OF CONSULTANTS AND MUST BE RI AT THE COMPLETION OF WORK.

  \* THIS DRAWING IS NOT TO BE USED FOR CONS UNTIL SIGNED BY THE CONSULTANT.

  \* DRAWINGS ARE NOT TO BE SCALED.

LEGENDS:-



**MEM ENGINEERING INC** 2355 DERRY ROAD EAST MISSISSAUGA, ON, L5S 1V6 905-673-9100

Email:harry@memengineering.ca



PROJECT TITLE:

LIKEWOOD

SHEET TITLE:

CLIENT EMAIL

CLIENT CONTACT

SCALE:

A00 CHECKED BY